


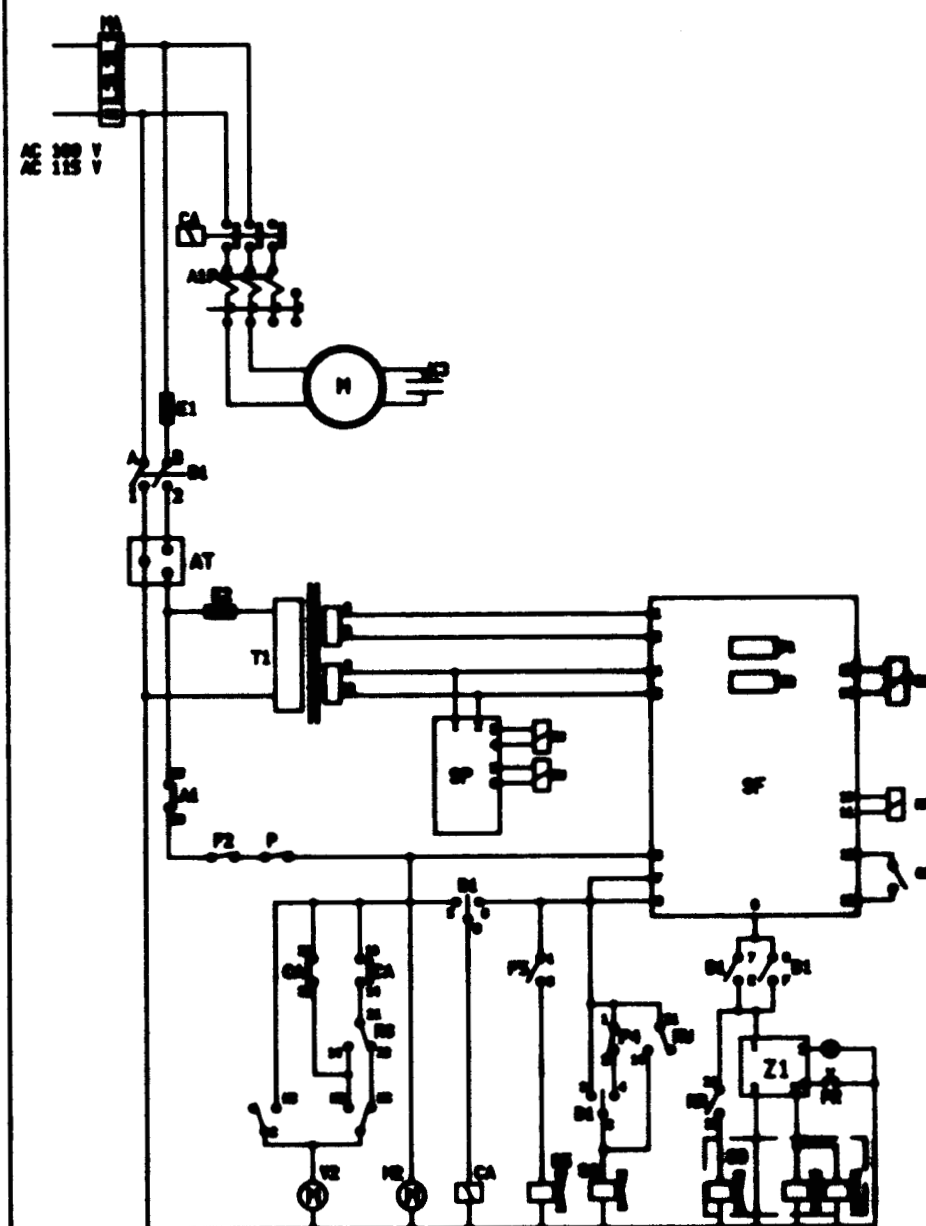

M	●	●	●	●	●	●	●	●	●
V	●	●	●	●	●	●	●	●	●
C	●	●	●	●	●	●	●	●	●
O	●	●	●	●	●	●	●	●	●
8	●	●	●	●	●	●	●	●	●
1	2	3	4	5	6	7	8	9	
A	B	C	D	E	F	G			

NOTE: THE POWER SUPPLY IS A 110 V AC, 50 Hz. THE MOTOR IS A 110 V AC, 50 Hz. THE RELAY IS A 110 V AC, 50 Hz. THE FUSE IS A 110 V AC, 50 Hz. THE SWITCH IS A 110 V AC, 50 Hz. THE TRANSFORMER IS A 110 V AC, 50 Hz. THE RECTIFIER BRIDGE IS A 110 V AC, 50 Hz. THE FILTER CAPACITOR IS A 110 V AC, 50 Hz.

NOTE: THE POWER SUPPLY IS A 110 V AC, 50 Hz. THE MOTOR IS A 110 V AC, 50 Hz. THE RELAY IS A 110 V AC, 50 Hz. THE FUSE IS A 110 V AC, 50 Hz. THE SWITCH IS A 110 V AC, 50 Hz. THE TRANSFORMER IS A 110 V AC, 50 Hz. THE RECTIFIER BRIDGE IS A 110 V AC, 50 Hz. THE FILTER CAPACITOR IS A 110 V AC, 50 Hz.

NOTE: THE POWER SUPPLY IS A 110 V AC, 50 Hz. THE MOTOR IS A 110 V AC, 50 Hz. THE RELAY IS A 110 V AC, 50 Hz. THE FUSE IS A 110 V AC, 50 Hz. THE SWITCH IS A 110 V AC, 50 Hz. THE TRANSFORMER IS A 110 V AC, 50 Hz. THE RECTIFIER BRIDGE IS A 110 V AC, 50 Hz. THE FILTER CAPACITOR IS A 110 V AC, 50 Hz.

NOTE: THE POWER SUPPLY IS A 110 V AC, 50 Hz. THE MOTOR IS A 110 V AC, 50 Hz. THE RELAY IS A 110 V AC, 50 Hz. THE FUSE IS A 110 V AC, 50 Hz. THE SWITCH IS A 110 V AC, 50 Hz. THE TRANSFORMER IS A 110 V AC, 50 Hz. THE RECTIFIER BRIDGE IS A 110 V AC, 50 Hz. THE FILTER CAPACITOR IS A 110 V AC, 50 Hz.

NOTE: THE POWER SUPPLY IS A 110 V AC, 50 Hz. THE MOTOR IS A 110 V AC, 50 Hz. THE RELAY IS A 110 V AC, 50 Hz. THE FUSE IS A 110 V AC, 50 Hz. THE SWITCH IS A 110 V AC, 50 Hz. THE TRANSFORMER IS A 110 V AC, 50 Hz. THE RECTIFIER BRIDGE IS A 110 V AC, 50 Hz. THE FILTER CAPACITOR IS A 110 V AC, 50 Hz.

LABORATORIO
VERIFICATO ED APPROVATO
Data 22/05/94 Firma *[Signature]*

PRO. VG110-210s	CON. VG 110-210S-1X100
DES. D.N.A.	CODICE 10.7.0408.0
DATA 22-05-94	